




## Installation Instructions

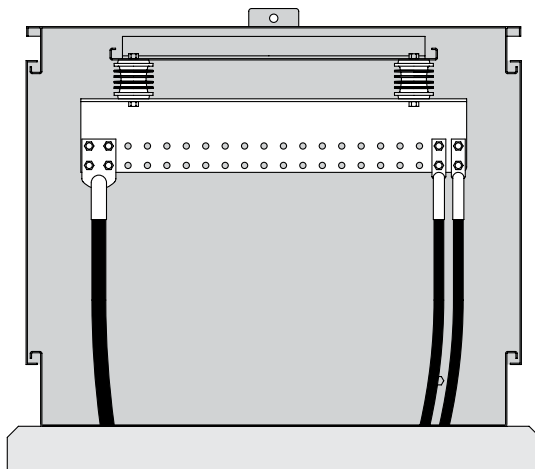

Max. Capacity = Bus Rating x 1.00  
Source and Load Cables  
connect to the ends of the bus

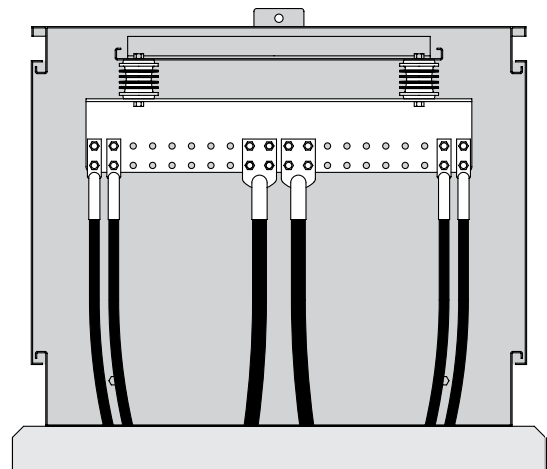


Max. Capacity = Bus Rating x 1.75  
Source Cables  
connect to the center of the bus  
Load Cables (equal loads)  
connect to the ends of the bus

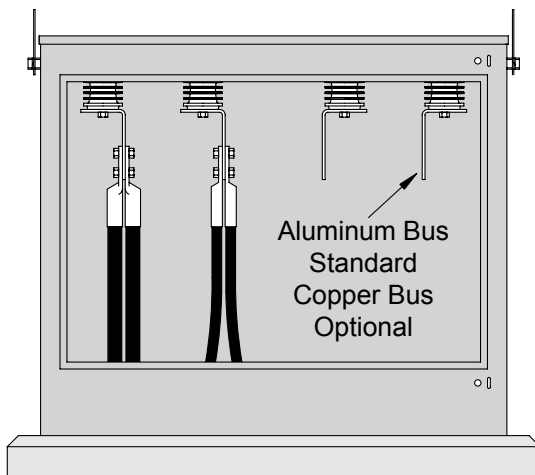

Open Bottom and Bus  
Arrangement allows access  
to all Cables for easy  
installation and maintenance

Ground Lugs  
Accept #6 - #2/0  
Ground Cable

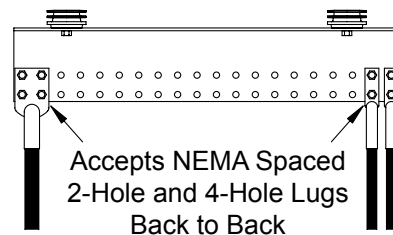

Co-ordinated Padlock and Security  
Bolt provides bolted door security  
with visual confirmation by  
Supervisory Personnel



## **600-Volt Secondary Bus Enclosure**

Single-Phase and Three-Phase  
Pad-Mounted – Outdoor

Tech Bulletin

**340-100**

Page 2      2009

**If you do not find the design  
you need  
PLEASE CONTACT  
our REPRESENTATIVE or the FACTORY**